


Wiring Diagram for a Single GB142 Boiler with Buderus AM10 reset & Taco ZVC Control

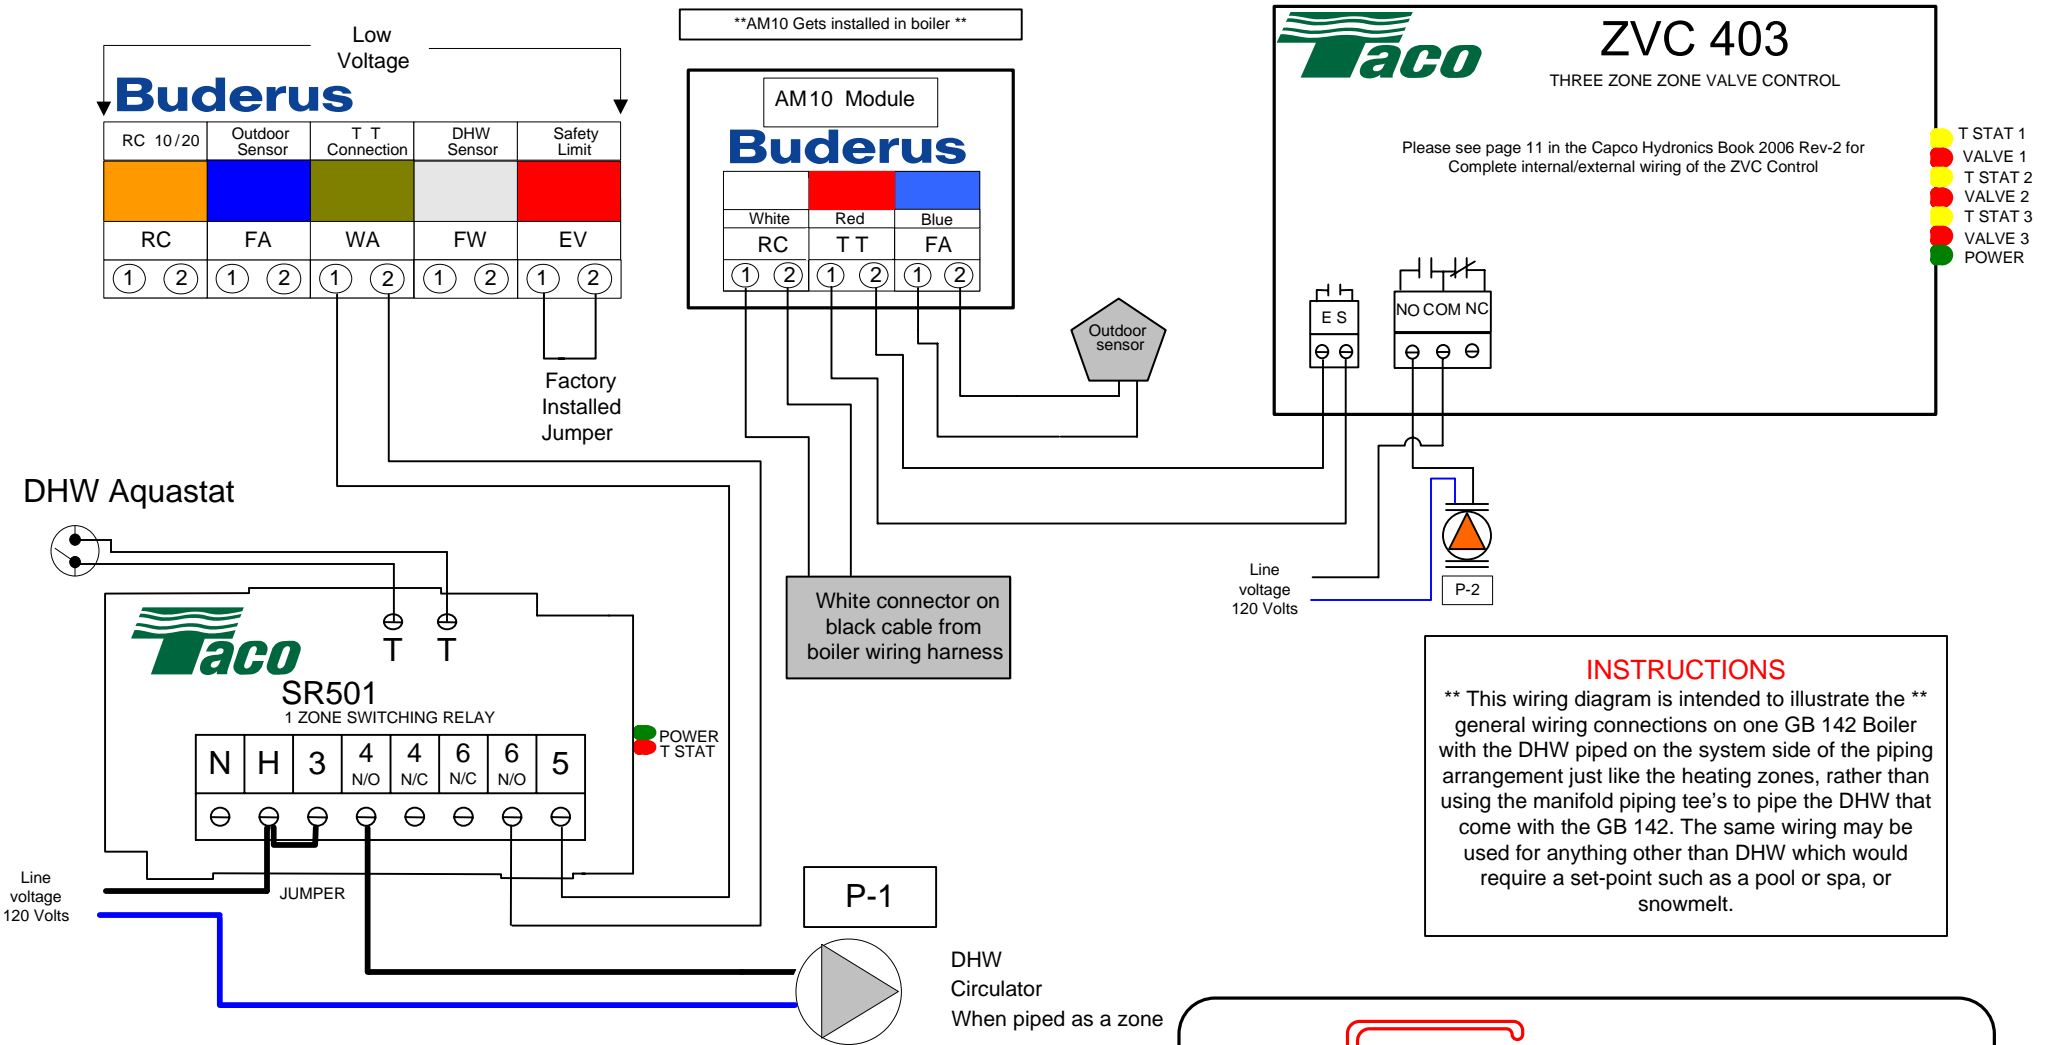

781-721-0303 FAX 781-721-9119 WWW.CAPCOSUPPLY.COM

10 INDUSTRIAL PARKWAY WOBURN MA 01801	GB142 With AM10, ZVC Control and DHW as a Setpoint piped off of System Piping	Michael Fox 09/06/2006
--	--	---------------------------

THIS IS ONLY A CONCEPT DRAWING. ALL CONDITIONS AND NECESSARY COMPONENTS MUST BE FIELD VERIFIED AND ARE THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR