


Aquastat:  
Run call to boiler through N.C. contacts to break at 150 - 160

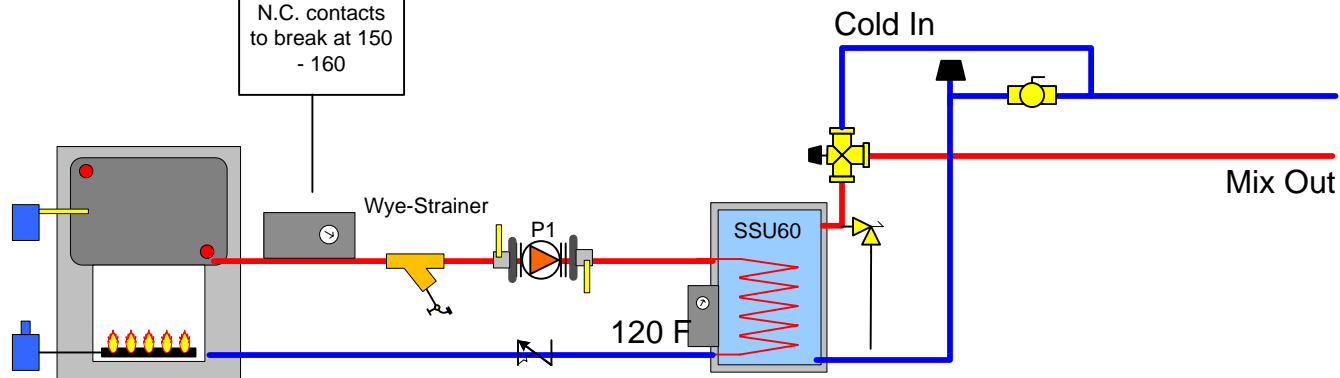

Steam Boiler  
Take Supply and Return tapings off below water line

**CAPCO**  
ENERGY SUPPLY, INC.

781-721-0303 FAX 781-721-9119 WWW.CAPCOSUPPLY.COM

10 INDUSTRIAL PARKWAY WOBURN MA 01801	DHW off Steam Boiler	11.11.11 GP
--	----------------------	----------------

THIS IS ONLY A CONCEPT DRAWING. ALL CONDITIONS AND NECESSARY COMPONENTS MUST BE FIELD VERIFIED AND ARE THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR